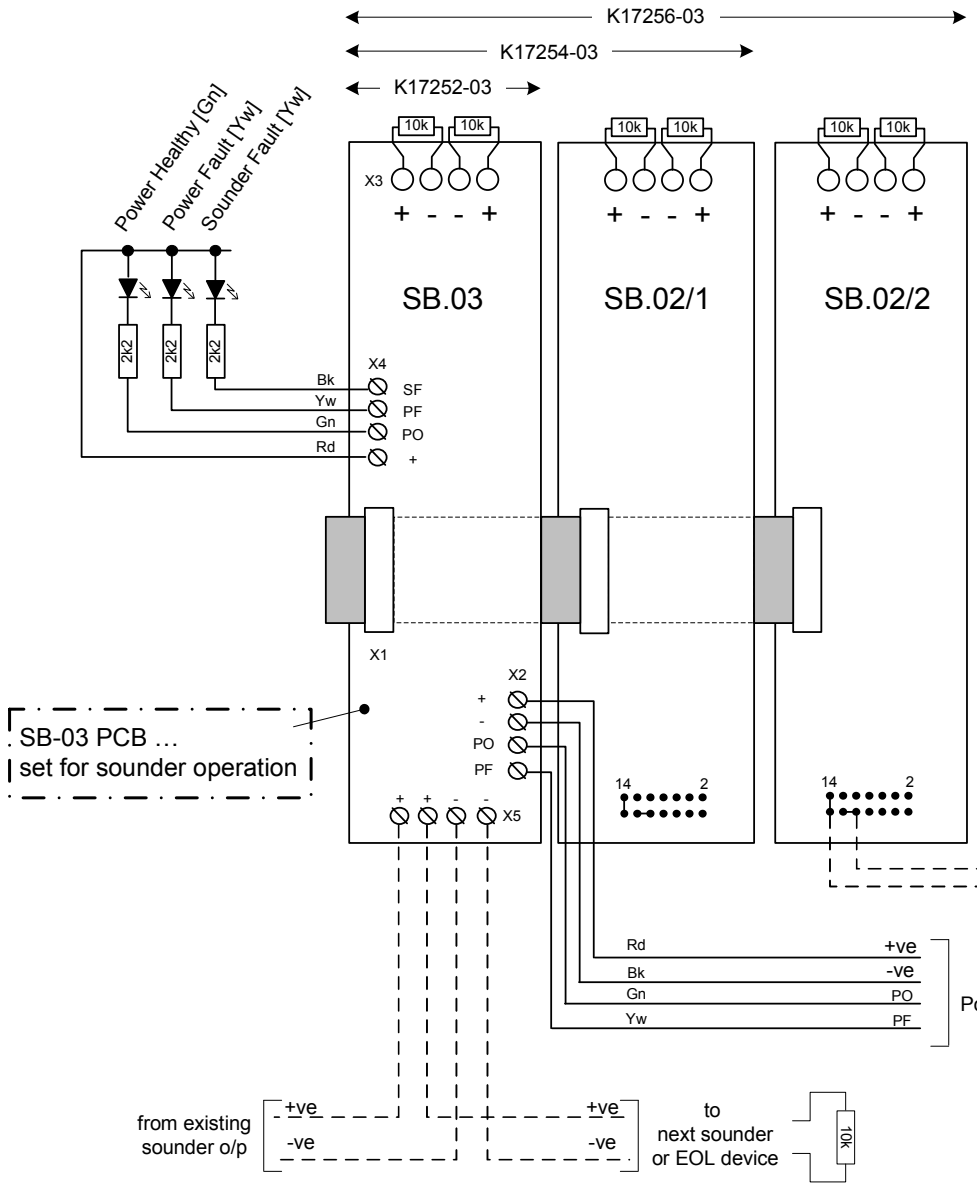

STANDARD BELL BOOSTERS VERSIONS:

K17252-03 [K1500] 2-way Bell Booster = SB.03 x1 no. & 2.5A PSU.

K17254-03 [K1510] 4-way Bell Booster = SB.03 x1 no. + SB.01 x1 & 2.5A PSU.

K17256-03 [K1520] 6-way Bell Booster = SB.03 x1 no. + SB.02 x2 & 4.0A PSU.

If more than 2 no. SB-03/SB-02 PCB's are to be fitted then 24v DC power must be wired to each additional SB.02 PCB.

REV	REVISION	REL/C NOTE	DATE
A	RELEASE	Pre '93	18/06/1991
01	DRAWN ON COMPUTER	———	28/03/2001
02	CHANGE	C8350	21/12/2007

TITLE: BELL/SOUNDER BOOSTER UNIT
~ Internal Circuit Wiring

CLIENT

DATE DRAWN 28/03/2001	DRAWN Ian D.	CHECKED BY R.J.
W/O No.	PSU/BATT as above	DRG No. K.929-02